

# TEST REPORT

K4 Soils Laboratory



## Sample Details


Certificate of sampling received: No  
Laboratory Ref No: K4-30149 - T1/3103/01  
Client Ref No: T1/3103/01 - SRH-Mar21  
Sampling Location: Seal Road Haulage - WRAP Compliance Testing March 2021  
Name of Source: Seal Road Haulage - WRAP Compliance Testing March 2021  
Date Sampled: 30/04/2021  
Date Received: 31/05/2021  
Date Tested: 09/07/2021  
Method of Sampling: Samples taken By Kalex  
Material Description: FMC Crushed Concrete with brick fragments and sand fines  
NMC (%): 7.0  
Aggregate Type and Nominal Size: Type 1 Crushed concrete  
Target Specification: SHW Series 800: clause 803 Table 8/5 overall grading range  
Type 1 Unbound Mixture

## Results:

Unrepresentative lumps were present : **NO**

BS Test Sieve	Cumulative Percentage Passing	Specification limits	
63.0	100	100	100
31.5	75	75	99
16.0	54	43	81
8.0	29	23	66
4.0	17	12	53
2.0	14	6	42
1.0	10	3	32
0.063	1.4	0	9

Percent in Fraction Size			
Fraction Size	Percentage	Specification Limits	
8/16	25	7	30
4/8	12	7	30

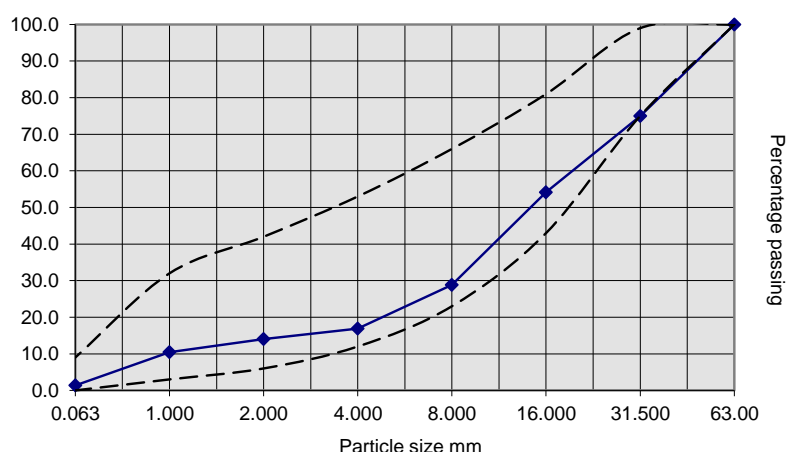

Sample complies with specification limits: **YES**



## Particle Size Distribution BS EN 933-1: 2012

Determination of particle size distribution of aggregate sample-washing and sieving method

Checked and Approved  
Initials: J.P  
14/07/2021

Test Report by K4 SOILS LABORATORY Unit 8 Olds Close Olds Approach Watford Herts WD18 9RU

Test Results relate only to the sample numbers shown above. Approved Signatories: K.Phaure (Tech.Mgr) J.Phaure (Lab.Mgr)

All samples connected with this report ,incl any on 'hold' will be stored and disposed off according to Company policy. A copy of this policy is available on request.